

Protech

is a registered trademark of the Protek Telecom and Electronics.

Protek Telecom&Electronics Confidential. [For internal and NDA customers]
Copyright 2005 Protek Telecom &Electronics. All Rights Reserved.

This document contains proprietary and confidential information of the Protek Telecom&Electronics. This document is not to be copied in whole or part.

Information furnished is believed to be accurate and reliable. However, Protek Telecom&Electronics assumes no responsibility for the consequences of use of such information nor for any infringement of patents or other rights of third parties which may result from its use. No license is granted by implication or otherwise under any patent or patent rights of Protek Telekom and Electronic Ltd.co. Specification mentioned in this publication are subject to change without notice. This publication supersedes and replaces all information previously supplied. Protek Telecom&Electronics products are not authorized for use as critical components in life support devices or systems without express written approval of Protek Telecom&Electronics.

Baskı/Ed-Tarih/Date					
İmza/Signature					
Baskı/Ed-Tarih/Date	1	14.12.2008			
İmza/Signature	Tamer Tansug				
Baskı Edition	1	Tarih Date	14.12.2008	Kod Code	PRO480 19000 AAAA - DE
				Sayfanın Sheets	8
				Sayfası Sheet	1.

Air to air Heat Exchanger Common Features

When the external temperature is lower than the internal temperature, and a maintenance free system is required, an air to air heat exchanger is the most convenient choice. Air to air heat exchanger, with the internal heat cooling sealed aluminium core, satisfy completely the market request by small dimensions, very high efficiency and new design. Our system has average 37K/W heat transmission rate. It is always supplied with deflectors for the outlet of ambient and enclosure air in order to optimize the enclosure thermal management.

Benefits

-No filter this model has the heat exchanger surfaces specially designed to prevent particles and fibres in the ambient air. They remain very efficient in the worst ambient conditions so filters are eliminated.

-Integral silicon covered silicon assure an IP55.


-There is electronic temperature measurement assures fully electronic heat management.

Technical Specifications of Hex37A

Voltage	53,5VDC		
Height/Width/Depth	725mm	444mm	131mm
Specific Max Heat Transmission	41 K/W		
Power absorbed (at full speed)	80 W		
Power absorbed (at min speed)	20 W		
Absorbed Current (max)	1.6 A		
Working limits ambient temp	-45 /+70 °C		
Side cabinet protection Degree	IP54		
Noise Level at max speed	60 dB (meets ETSI 300 753)		
Alarm (Heat Exchanger Major)	Dry Contact		
Over Temperature Alarm	Dry Contact		
Alarm Led	Red		
Test port	Max speed and major/Ov temp led		
Material	Aluminium		
Temperature Control	Electronic		
Internal/External Fan	380 m3/h		
Position	Door		



Figure 1. View of Hex37A

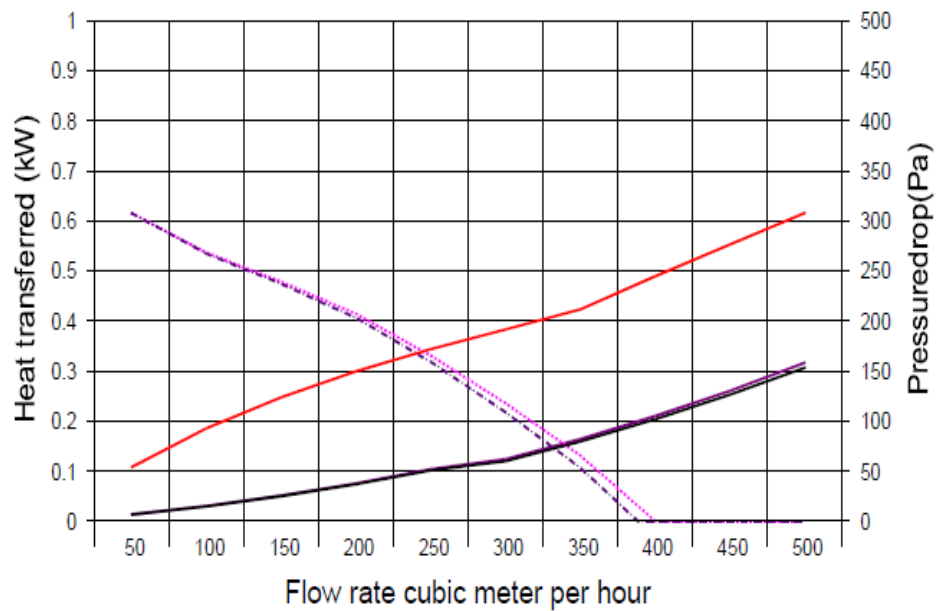

34-41 W/K |

Temp: 55/ 45 Qmax: .41kW Qred: .41kW Qredfan: .34kW Tempin: 50.9 C 50.9 C
 Exhaustflowred: 332m3/h(72Pa) Supplyflowred: 331m3/h(74Pa)

Figure 2. Heat core versus fan heat discharging transfer Diagram of Hex37A

HEX 37A TECHNICAL QUALIFICATION

Goal

This document describes the design and the functional requirements of the heat exchanger Hex37A used for Outdoor cabinet. Fresh air-cooling is not allowed in outdoor. The Hex37A helps the airflow inside the cabinet isolated from that outside. The two airflows are separated by heat core; blowers in each circuit force the air. The rotation of blowers is temperature controlled.

Compatibility

In the Outdoor cabinet heat exchangers from different manufacturers can be used. The different heat exchangers must be compatible in respect to bellow considerations such as;

- Overall dimensions
- Mechanical interface (fixing points to cabinet)
- Electrical interface (input voltage, connectors etc.)

General design rules are given in this specification to be adaptable any outdoor cabinet. Blower redundancy is not requested.

Design

The Hex37A consists of a box divided in inner and outer circuit. The air circulating in one circuit is separated from the air in the other circuit by the features of heat core mechanical structure. The core consists of thermally conductive material allowing heat exchange between the both circuits. One blower in each circuit circulates the air.

Dimensions

Overall dimensions are chosen to allow mounting of heat exchanger into specified cabinet. See drawing in fig:

	Height (mm)	Width (mm)	Depth (mm)
Hex37A:	725	444	131

Weight

Maximum 8 kg

Materials and surface finish

Overall housings: Aluminum

Core: Thermo conductive material

Plastics: Halogen free UL94-V2 or better

PCB: UL94-V0

Surface finish:

- EMC relevant surfaces is for conductive treated
- Sharp edges is avoided to prevent injury

Mounting

4+4 screws according to drawings in fig1, Screw type M5x170. Appropriate tubes are mounted across Hex37A case to guide the screws.

Fixation lid to case

Quick locks and/or minimum screws are used to fix heat exchanger lid.

Protection class

IP 55 (between inner and outer circuit, being integrated into cabinet)

Functional Specification**Power input**

Nominal input voltage: 53,5V
 Input voltage range: 42 to 60V
 Protections: Fuse in 48Vlead, T 2.5A
 Inverse voltage protects: Yes
 Blower blocking: Yes
 Input power at average working: 10-80W depending of fan speed.
 DC inrush current at nominal input voltage: 4A

Cooling efficiency

Cooling efficiency at U_n : > 37W/K

Acoustic noise


Stand alone conditions, free blowing, inner and outer circuit at max specified speed: < 60 dB (A) (sound pressure measured in 1m distance in front of fan side)

Applicable standard on cabinet level: ETS 300 753, non-weather protected location, protected area class. Stated limits apply to noise generated by equipment during continuous operation. Short period violation occurring at switch-on of blowers is allowed.

Blower rotation control

Temperature controlled regulation is used for blower rotation, inner and outer blowers are independent from each other. The control of blowers is internal function of heat exchanger. Control unit is assembled inside of inner circuit.

Regulation diagram:

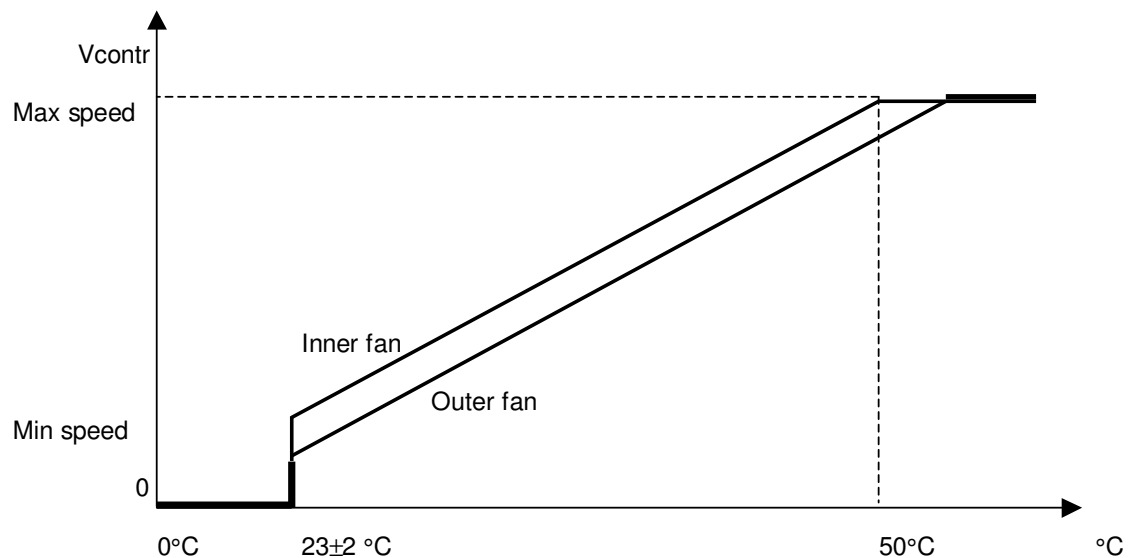

Maximum rotation is adjusted to fulfill both cooling and acoustic noise requirements. The regulation range is manufacturer specific, defined after tests in cabinet and agreed with respective manufacturer. After switch-on the blowers' speed is accelerated continuously up to maximum specified rotation. Then the speed is regulated down to specified ramp by the controller. Duration of start-up loop is 10 - 15 second.

Temperature sensor

Temperature sensor is mounted in heat exchanger at the air inlet of inner circuit.
In case of failure of temperature Sensor (e.g. sensor disconnected or short circuited) causes following response such as;

- All blowers are rotating with full-specified speed.
- Alarm occurs, red LED is lit, and over temperature red LED is lit.
- The response may be delayed up to about 5 second after the failure occurred.

Test port

SubD female connector located close to power-in/alarm connector. The test port allows connecting external temperature simulator setting respective temperature value to check blower operation depending upon temperature. An external short circuit plug can be used at the connector. In case of response on removed short circuit plug causes following responses such as,

- All blowers are rotating with full speed.
- Alarm occurs, red LED is lit.
- The response may be delayed up to about 5 second after the failure occurred.

Alarm

One alarm output per heat exchanger. Alarm is being raised in case of

- At least one blower fails
- Temperature sensor/plug disconnected
- Temperature exceeds 50 °C
- Temperature drops below 0 °C

Note:

- Periodical trigger usually starts the blowers. At least 2nd trigger must be awaited before raising alarm (delay alarm about 6 sec.)
- Automatic alarm reset: If failure absent, alarm is disappeared.
- At intentional standstill (temperature lower than blower switch-on threshold) no given alarm indicating.
- Alarm loop must be "not-conductive (alarm ON)" when primary DC is switched off.

The alarm output is isolated by relay like bellow:

<u>Operation Status</u>	<u>Loop Status</u>	<u>Voltage</u>	<u>Current</u>
Normal	Normally Closed	0 V	1A
Alarm	Make open	Open	0A

LED alarm indication

Hex37A major alarm is realized by means of a red LED.
The red LED is off in case of relevant alarm removed.

Connectors

Power/Alarm:

DSub 9 pin male (pin contacts) Description

Pin assignment:

- 1 * Nc
- 2 * 48V
- 3 * 48V
- 4 * Nc
- 5 * Nc contact (Major)
- 6 * 0V
- 7 * 0V
- 8 * Nc
- 9 * Dry contact (Major)

The DC IN voltage, both + and -, is split to two pins for higher current capability.
In the controller the pins are for dc power input 2-3 and 6-7, respectively.

Test port (temp. sensor port):

D sub 9pin female (socket contacts)
Pin assignment:

1*Nc
2*Nc
3*Nc
4*Nc
5*Nc
6*Nc
7*Nc
8* Connection to 9*
9 *Connection to 8*

Reliability

Controller MTBF is minimum 20 years. Calculation has made at ambient temperature 50°C.
Blowers are maintenance free type, which sealed ball bearing.

Burn-in

When manufacturing process is running, every produced Hex37A is done test under the conditions (only functional test).
Also 10% of 100 pcs can be applied long max speed test such as 24 hours, 60°C, full load.

Safety

The Hex37A meets the requirements of EN 60950 for SELV circuits and danger of energy.
Blowers, Heatcore, control board meet UL and CE certification.
Fire protection class of plastic parts acc. UL94-V2
Fire protection class of printed boards acc. UL94-V0

Grounding:

Hex37A case conductive is connected to DSL outdoor cabinet by means of fixing screws.

Environmental conditions

- Ambient temperature range at any level for blowers, heatcore and control board: -45°C to +70°C
- Humidity range: 95%

Storage conditions

-45°C to +80°C

Electromagnetic compatibility

Conducted emission on DC lines according to: EN 55022 class B
Radiated emission: EN 55022 class B (mounted in cabinet, sealing between inner and outer circuit)